


Symb.	Changes	Date/Sign.

No. Unit	Pos. No.	Name, type, dim.	Drawing no. Standard	Art. No.	Matr. Spec.
Date	01-01-10	Drawn P. Gaasvik	Projection 	Scale	
Checked		Appr.			
TILKOBLINGSSKJEMA				Replaces:	Replaced by:
ALBATROS S9 X VANN 230V				341719	Page 1/3



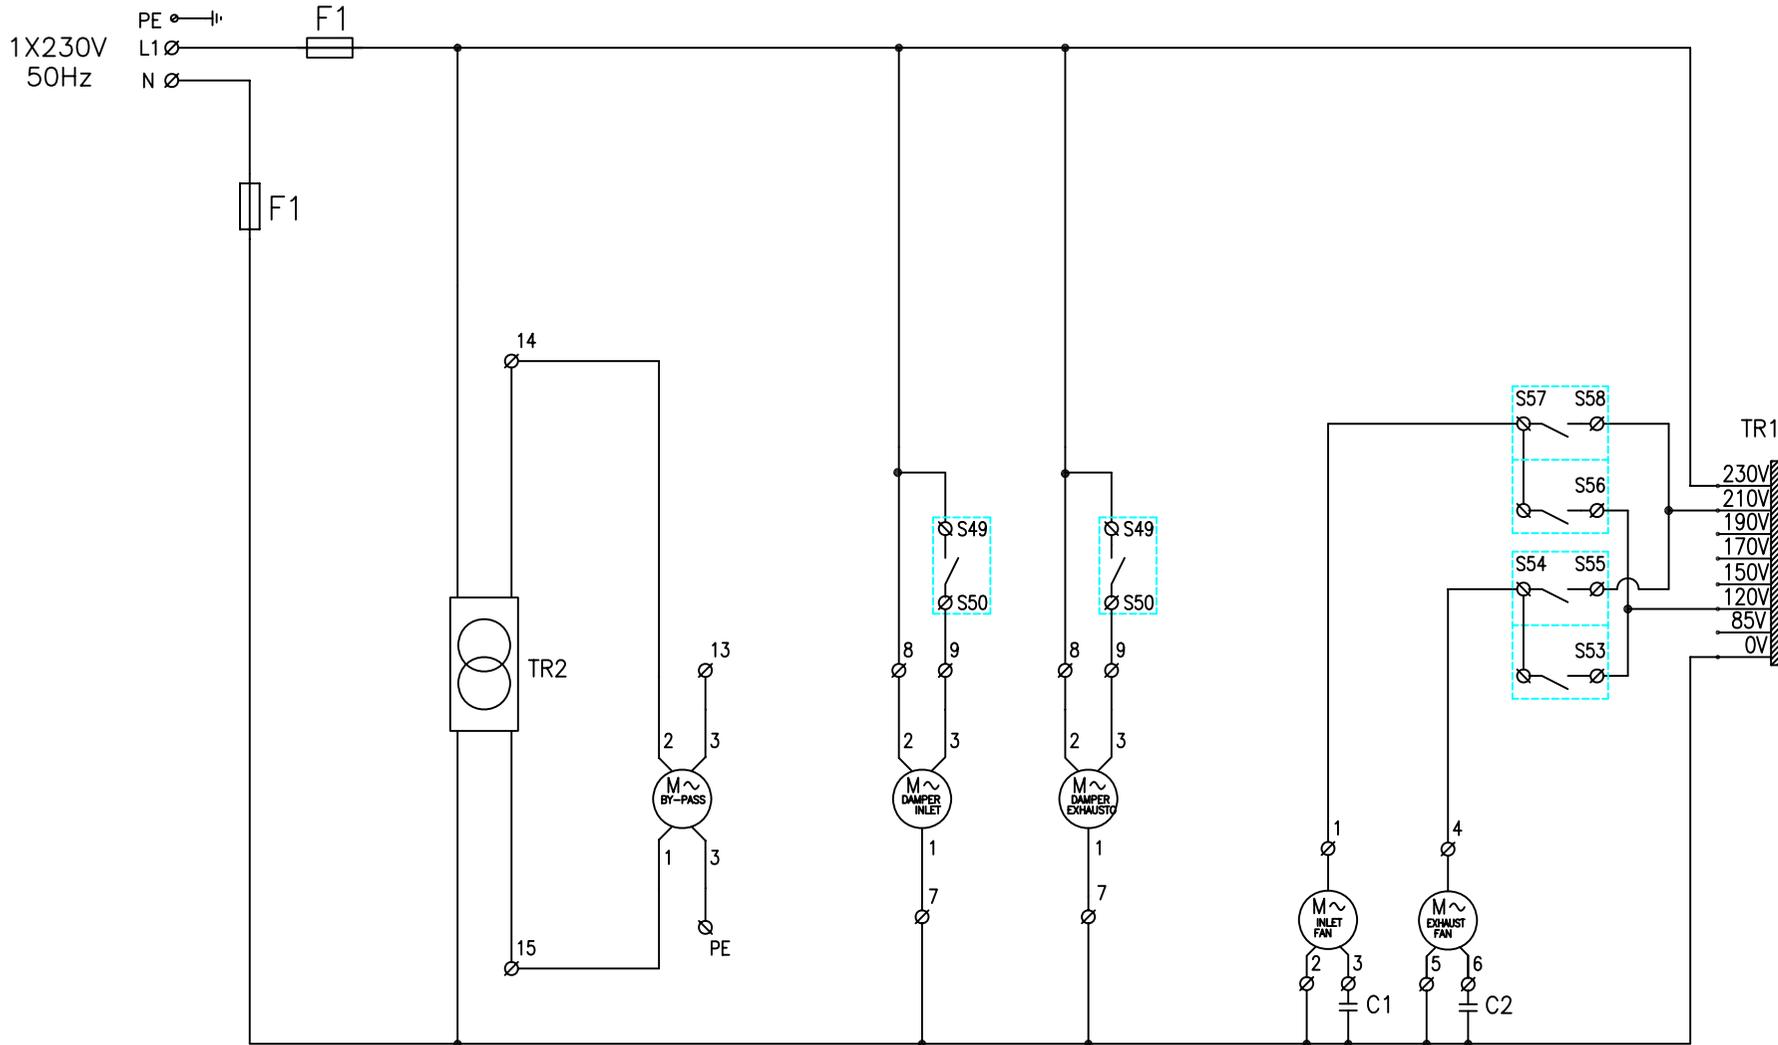


XX: MAIN TERMINAL BLOCK
 SXX: TERMINAL BLOCKS ON CONTROL BOARD
 TXX: TERMINAL BLOCKS ON SMALL CONTROL BOARD
 F1: FUSE 2X10A
 C1-C2: CAPACITOR 8uF
 TR: TRANSFORMER

1	ENDRET TEGNING	Changes	03.09.02/JAN
			Date/Sign.
Symb.			

No. Unit No.	Pos. No.	Name, type, dim.	Drawing no. Standard	Art. No.	Matr. Spec.
Date	01-01-10	Drawn	P. Gaasvik	Projection	Scale
Checked		Appr.			
KOPLINGSSKJEMA				Replaces:	Replaced by:
ALBATROS S9 X VANN 230V				341719	Page 2/3



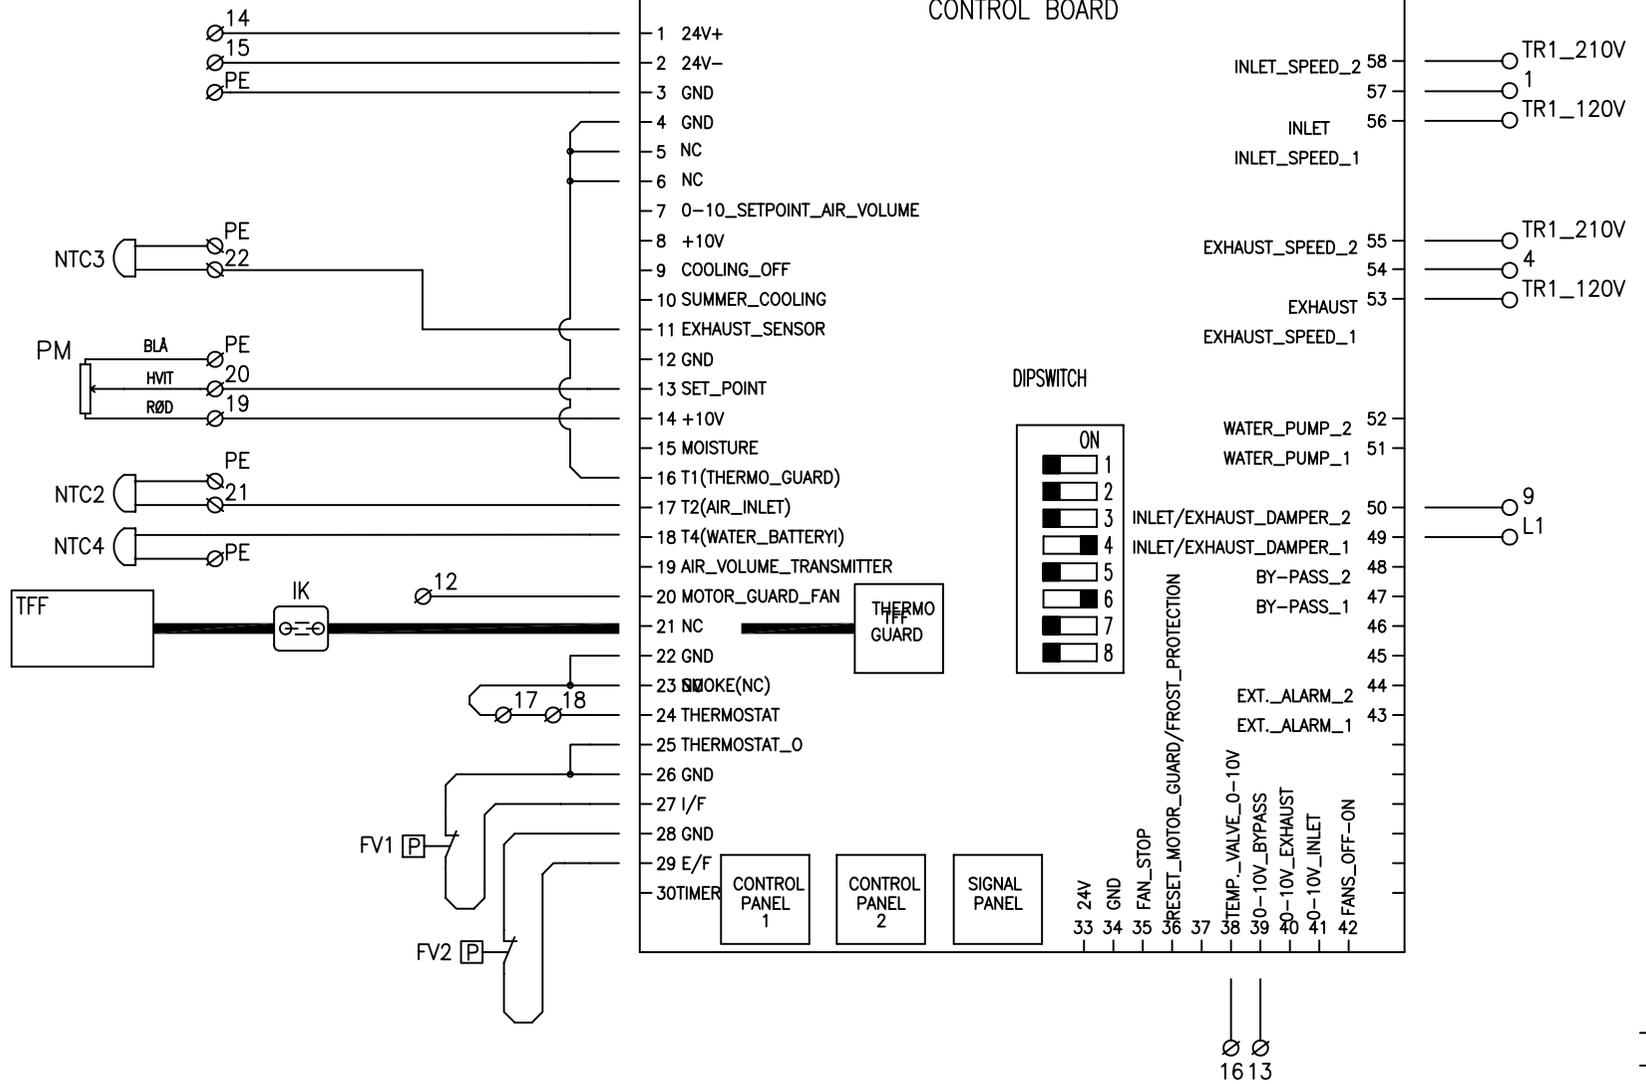

- NTC2: Temperature sensor, inlet
- NTC3: Temperature sensor, exhaust
- NTC4: Temperature sensor, water battery
- PM: Set point heating temp.
- FV1: Filter guard, inlet
- FV2: Filter guard, exhaust
- TR1: Trafo-fan regulation
- TFF: Thermo guard

	OFF	ON
1	UNIT WITH WATER BATTERY	UNIT WITH EL. BATTERY
2	NO FUNKTION DURING NIGHT-TIME REDUCTION	FAN STOPP CONNECTION WITH NIGHT-TIME REDUCTION
3	NO FUNKTION DURING NIGHT-TIME REDUCTION	REDUCES INLET TEMP. BY 3°C AT NIGHET-TIME
4	NO FUNKTION DURING NIGHT-TIME REDUCTION	REDUCES FAN SPEED AT NIGHT-TIME
5	NO FUNKTION	FOR TEMP. CONTROLLED FAN REDUCTION
6	UNIT WITH PRE HEATING	UNIT WITH BY-PASS OR ROTOR
7	NO FUNKTION	CONTROLS TEH DIFFERENT ELEMENT GROUPS
8	UNIT WITH ISDN THERMO GUARD	UNIT WITH THERMO GUARD

Changes	Date/Sign.
Symb.	

No. Unit	Pos. No.	Name, type, dim.	Drawing no. Standard	Art. No.	Matr. Spec.
Date	01-01-10	Drawn P. Gaasvik	Projection	Scale	
Checked		Appr.			
KOPLINGSSKJEMA				Replaces:	Replaced by:
ALBATROS S9 X VANN 230V				341719	Page 3/3